
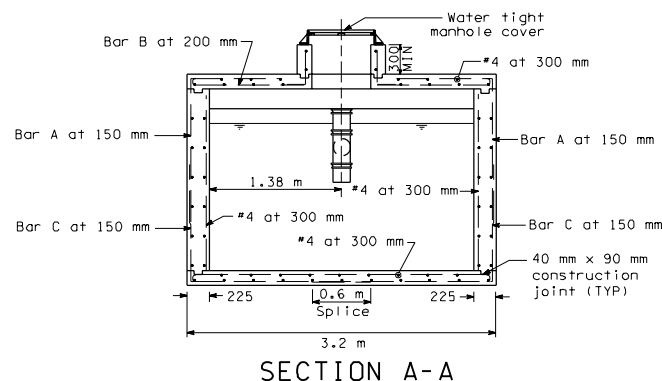
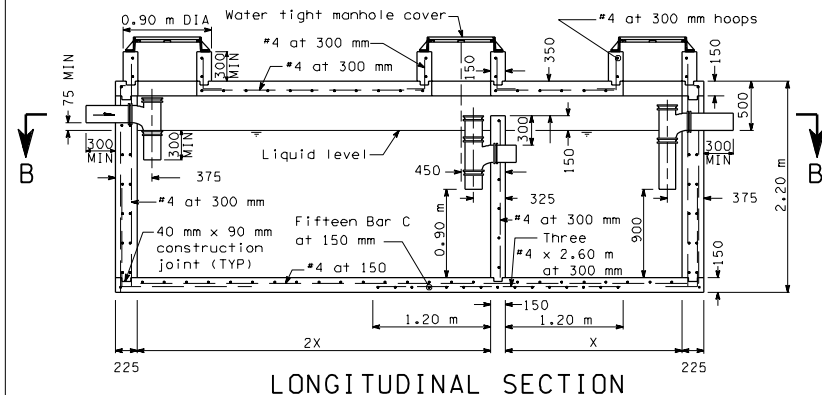
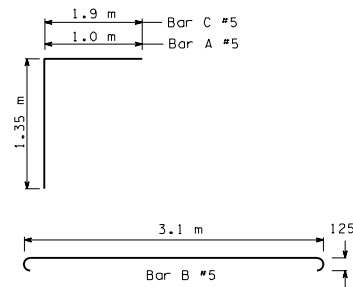
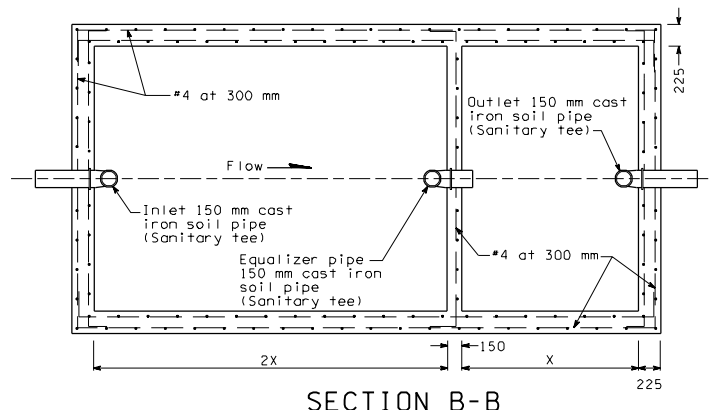


APPROXIMATE QUANTITIES				
Tank Capacity	Length (X)	Concrete	Steel Reinf. Bars	Cast Iron Soil Pipe & Fitting
m ³	m	m ³	kg	kg
25	2.0	18	1900	210
30	2.4	20	2100	210
35	2.7	22	2300	210
40	3.1	24	2600	210
45	3.5	26	2800	210
50	3.9	29	3000	210

- NOTES:
1. Approval of local health department is required before work is started.
 2. Excavated material shall be disposed of as directed by the Engineer.
 3. All work shall be left open until inspected and approved by the Health Officer and the Engineer.
 4. All grades shall be checked and approved by the Engineer.
 5. Water tight manhole covers shall be approved by the Engineer prior to installation.
 6. Precast septic tanks are acceptable, subject to the approval of the Engineer. Materials shall meet or exceed those shown.
 7. Plan dimensions may vary as site conditions and system design permit.
 8. All concrete shall be Class 28.
 9. Reinforcing steel shall be Grade 300 or Grade 400.

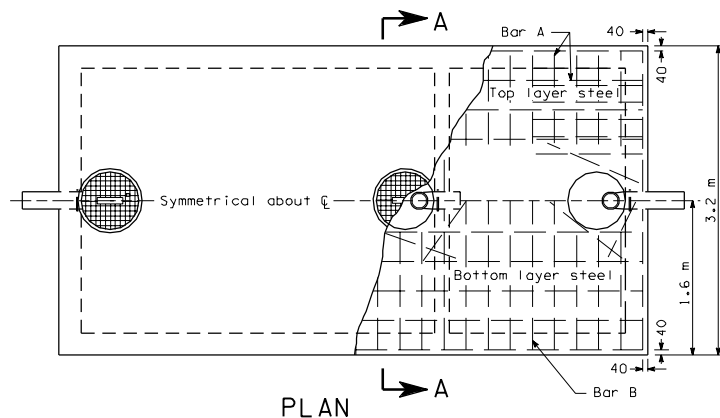

BAR DETAILS

ALL DIMENSIONS ARE IN MILLIMETERS
UNLESS OTHERWISE NOTED

REST AREA SEPTIC TANK

STANDARD PLAN I-1

APPROVED FOR PUBLICATION

STATE DESIGN ENGINEER

DATE _____

WASHINGTON STATE DEPARTMENT OF TRANSPORTATION
OLYMPIA, WASHINGTON